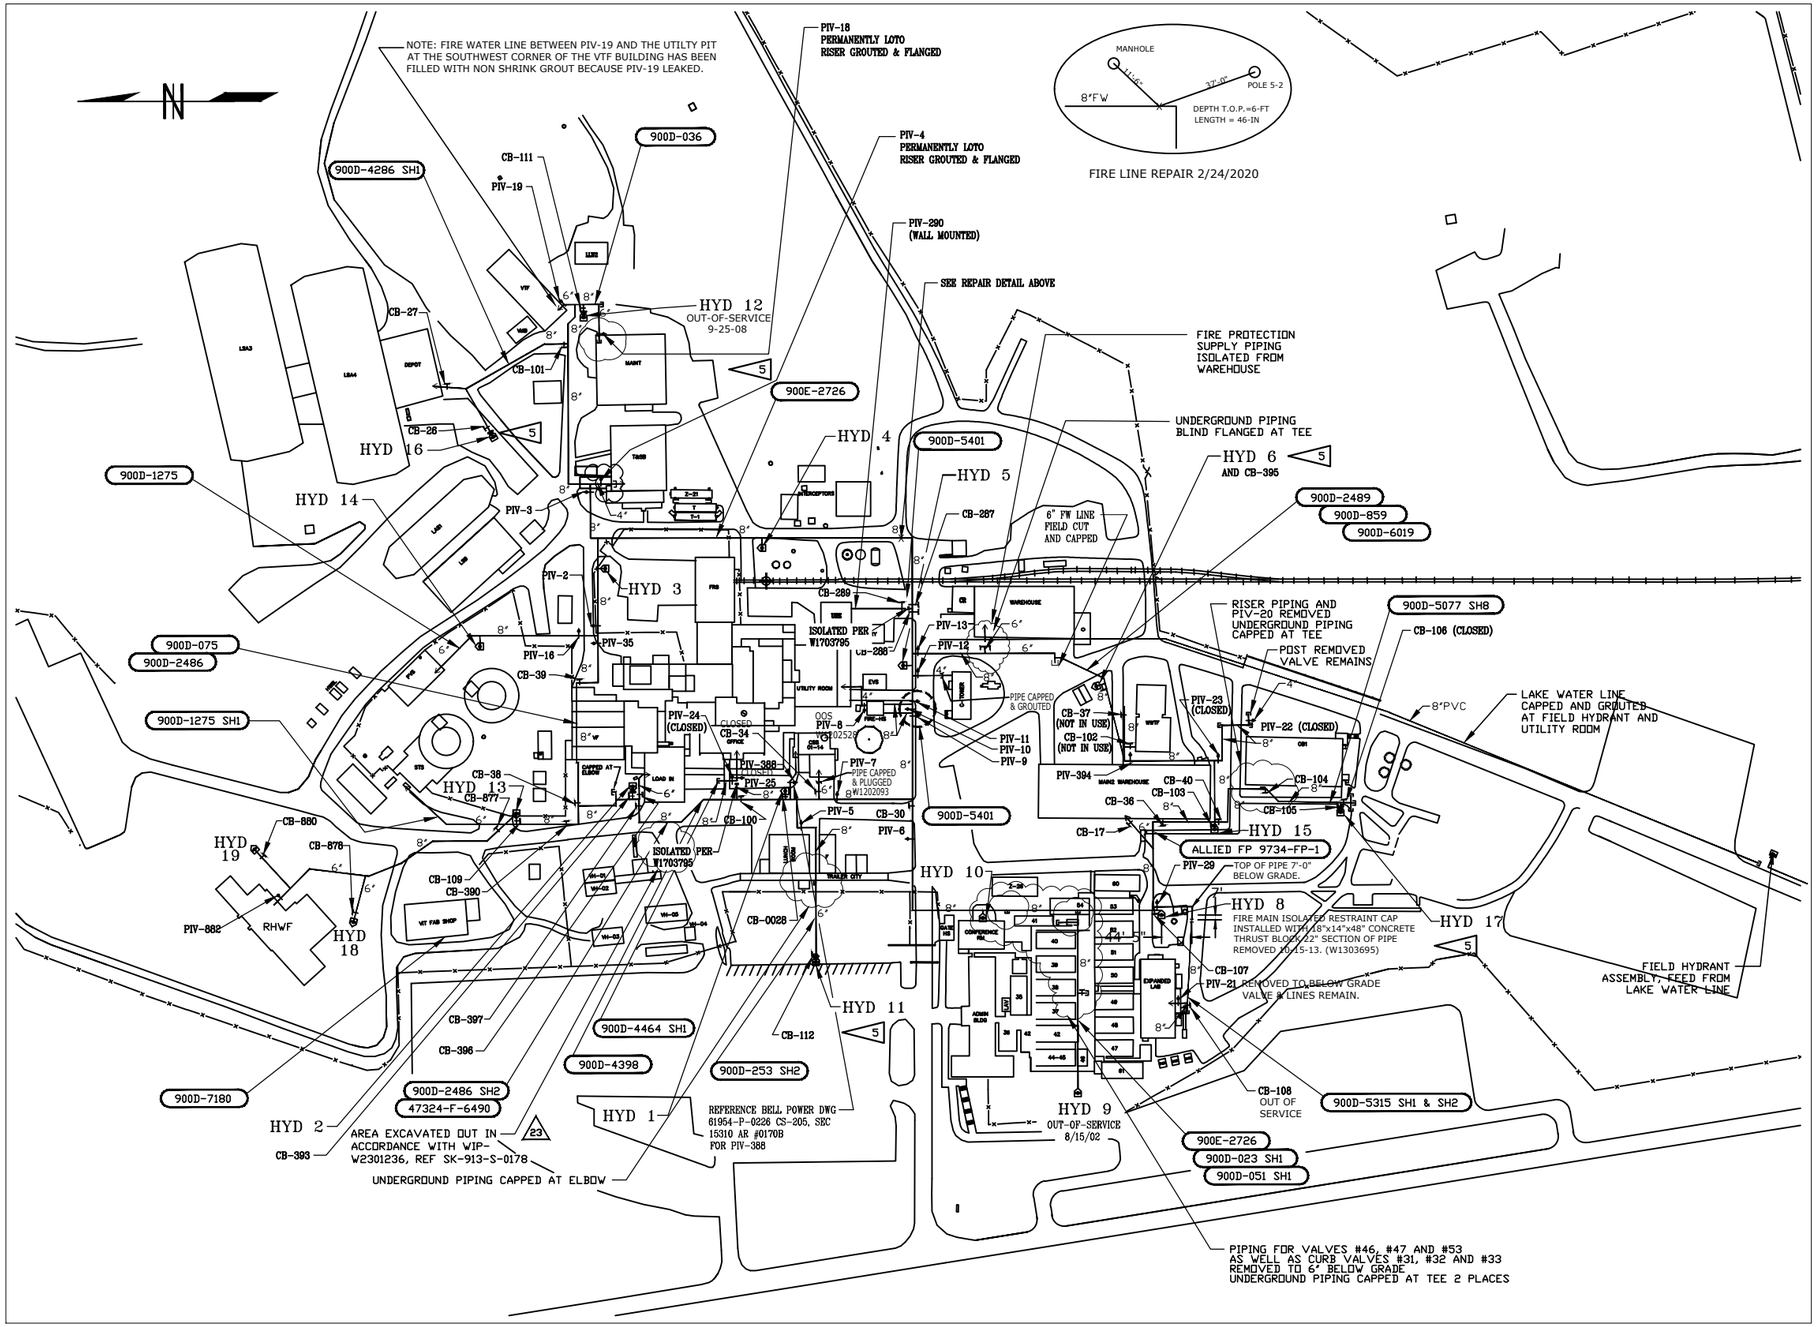

REF DWGS:

900D-036	FIRE MAIN EXTENSION MAINTENANCE & LLWTF
900D-075	CTS FIRE MAIN RELOCATION
900D-253	OFFICE COMPLEX INSIDE SECURED AREA SITE PLAN, SEWER, GAS, WATER, FIRE MAIN & ELECTRIC
900D-859	NEW WAREHOUSE SITE PLAN
900D-1275	STS - UTILITY & PROCESS LINES GENERAL LAYOUT
900D-2486	VITRIFICATION UNDERGROUND FIRE MAIN LOOP MODIFICATION
900D-2489	UTILITY LINES FROM UTILITY ROOM TO SEWAGE TREATMENT PLANT
900E-2726	R & S FIRE PROTECTION WATER SUPPLY PLAN
900D-4286	LSA3 & LSA4 STORAGE STRUCTURES UTILITY SERVICES
900D-4398	VIT. FAC. UNDERGROUND PIPING, DRAINAGE AND ELECTRICAL CONDUITS
900D-4464	PLANT OFFICE BLDG FIRE PROTECTION PIPING
900D-5077	DOUBLE A TRAILER PHASE 2 AREA SITE PLAN
900D-5315	EXPANDED LAB UTILITIES ABOVE & BELOW GRADE
900D-6019	SYSTEM 33 MAIN 2 WAREHOUSE EAST SIDE FIRE MAIN RELOCATION
900D-5401	UTILITY ROOM EXPANSION CIVIL UTILITY DRAWING
900D-7180	VIT HILL HARDSTAND, VIT SUPPORT FAB SHOP & UNDERGROUND UTILITY SERVICE

ABBREVIATIONS:

HYD	HYDRANT
CB	CURB BOX VALVE
PIV	POST INDICATOR VALVE

LEGEND:

- CURB BOX VALVE
- POST INDICATOR VALVE
- FROST PROOF HYDRANT (2 1/2" HOSE CONNECTION)
- FROST PROOF HYDRANT (PUMPER CONNECTION & 2 1/2" HOSE CONNECTION)
- XXXX-XXXX — REFERENCE DRAWING FOR FIRE MAIN LINES IN AREA

7 HYDRANT #9 PLACED OUT-OF-SERVICE AUG 2002 HYDRANT IS NOT OPERABLE

6 HYDRANT #16 UPDATE. REFERENCE P.O. 19-094620-C-CA, AR #53 FOR VENDOR DRAWING REFERENCE.

5 ALL KENNEDY MODEL K81 HYDRANT VALVE SEATS CHANGED IN 1996.

4 HYDRANTS WITH HOSE CABINETS WILL HAVE IDENTICAL NUMBERS & CLOSE RELATED LOCATIONS

3 CB-31 IS UNDER TRAILER 54, AN ACCESS HATCH IS PROVIDED IN TRAILER 54.

2 ALL VALVES SHOWN ON THIS DRAWING BEGIN WITH THE PREFIX 33-FP- .

1 ALL HYDRANTS AND POST INDICATOR VALVES SHOWN ON THIS DRAWING HAVE BEEN LOCATED BY SURVEY COORDINATES. FIRE LINE LOCATIONS CAN BE RE-ESTABLISHED IN THE FEILD BY USING THE COORDINATE INFORMATION AVAILABLE FROM THE DATA BASE USED WITH THIS DRAWING. CONTACT FACILITY ENGINEERING FOR ASSISTANCE.

NOTES:

QTY REQD	ITEM NO.	NOMENCLATURE OR DESCRIPTION	PART OR IDENTIFYING NO.	MATERIAL OR SPEC

PARTS LIST

REV	DESCRIPTION	APVD
0	BASELINE 09/01/94	JRH
1	ECN 8922 MJL 5/10/95	HAB
2	ECN 9040 MJC 6/21/95	KG
3	ECN 9178 MJL 8/30/95	KG
4	ECN 9847 ERP 4/24/96	BH
5	GEN/ECN 10327 JHS 10/16/96	BH
6	ECN 10598 DLL 3/27/97	HAB
7	ECN 12176 DMM 5/12/2000	JLH
8	GEN/ECN 13475 CGR 9/23/2002	HAB
9	ECN 25600 JLH 7/10/2003	HAB
10	ECN 26103 HAB 06/17/2005	HAB
11	ECN 26333 CGR 2/2/2006	DFP
12	ECN 26377 CGR 5/2/2006	DFP
13	ECN 26403 JML 1/3/2007	BMT
14	ECN 26544 DRS 06/26/2007	BMT
15	ECN 26599 DRS 08/29/2007	BMT
16	ECN 26521 DRS 10/16/2007	BMT
17	ECN 26739 DRS 10/16/2008	JML
18	ECN 27166 DRS 03/03/2011	BMT
19	ECN 30123 DRS 12/06/2012	PJD
20	ECN 30266 DRS 11/19/2013	JPD
21	ECN 30730 PJF 03/30/2020	JPD
22	ECN 30953 PJF 09/17/2020	MVV
23	ECN 31212 JHS 05/03/2023	JJN

VERIFY ALL DOCUMENTS FOR CURRENT REVISION AND PENDING CHANGES PRIOR TO EACH USE
INIT _____ DATE _____

UNLESS OTHERWISE SPECIFIED		DRAFTER C. RDBLEE	DATE 6/29/93
ALL DIM IN INCHES		CHECKER K. QUEALY	DATE 8/31/94
TOLERANCES-DO NOT SCALE		ENGR. G. WOODWORTH	DATE 9/1/94
2 PL DEC ± N/A	3 PL DEC ± N/A	ANGLES ± N/A	T. ALLAN 9/1/94
FRACTIONS ± N/A			CDG.MGR.APPVL J. JABLONSKI DATE 9/1/94
D.SPEC.NO. 1992			SYS.ENGR.APPVL R. THOMAS DATE 9/1/94
NEXT ASSEMBLY			Q.A.APPVL DATE
			DFTG.SUPR. J. HORTON DATE 9/1/94

A/E CONTRACT NO. | CODE IDENT. NO.

FOR
WEST VALLEY NUCLEAR SERVICES CO.,INC.
WEST VALLEY, NEW YORK

SYSTEM 33 WVDP FIRE PROTECTION MAIN LINES

DWG SIZE D | SCALE 1=100 | WEIGHT | DWG NO. 900-D-52842 | REV 23 | A/E DWG NO. | SHEET 1 OF 3

CAD DRAWING-DO NOT REVISE THIS ORIGINAL

1=100
204667

PLOT: 1=1